


WELL LOG 6A (6" CSG)
SCALE: 1/8" = 1'

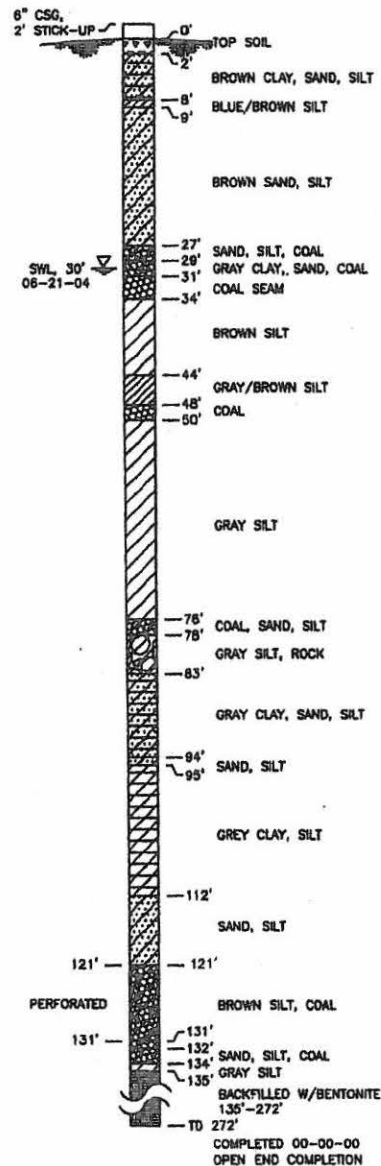

WELL LOG 6C (6" CSG)
SCALE: 1/8" = 1'

GENERAL NOTES:

SCOPE OF WORK

Furnish, test and commission fully operational and functional water treatment system capable of continuously producing 43 gpm treated water for Voznesenka community water system, including, but not limited to:

1. Arsenic, iron, and manganese treatment system. Guarantee removal to 5 ppb or less As, 200ppb or less Fe, and 40 ppb or less Mn.
2. Greensand Plus media for removal of above contaminants.
3. Mixed-bed anion pre-treatment system.
4. All vessels, filter media, backwash pump, air blower, valves, fittings, piping and appurtenances.
5. All equipment and appurtenances must fit within existing 20' x 40' treatment building approximately as shown on Drawings.
6. Equipment installation, sitework, general mechanical and electrical work will be performed by owner.

Location: Voznesenka, Alaska, Mile 20.2 East End Road, near Homer



95% REVIEW SET
NOT FOR CONSTRUCTION

REVISIONS	
VILLAGE SAFE WATER	
<p>WELL LOGS - 6A & 6C SCOPE OF WORK</p>	
<p>VOZNESENKA WATER SYSTEM WATER TREATMENT SYSTEM</p>	
<p>CONSULTING ENGINEERS, INC.</p>	
<p>Mike Taurainen, P.E.</p>	
<p>DATE: JAN 03 DRAWN: AN, CH CHECKED: MT CADD FILE: UTR TWT PROJ. NO.: 04108</p>	
<p>SHEET</p>	
<p>G1</p>	
<p>OF 8</p>	